NOTES:

1) CONFIGURATION AND THICKNESS OF CONCRETE PAD TO BE DETERMINED BY OWNER'S CIVIL ENGINEER.
2) DIMENSIONS AND WEIGHTS SHOWN ARE APPROXIMATE

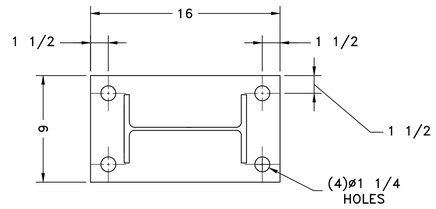

BASE PLATE
SCALE 2X

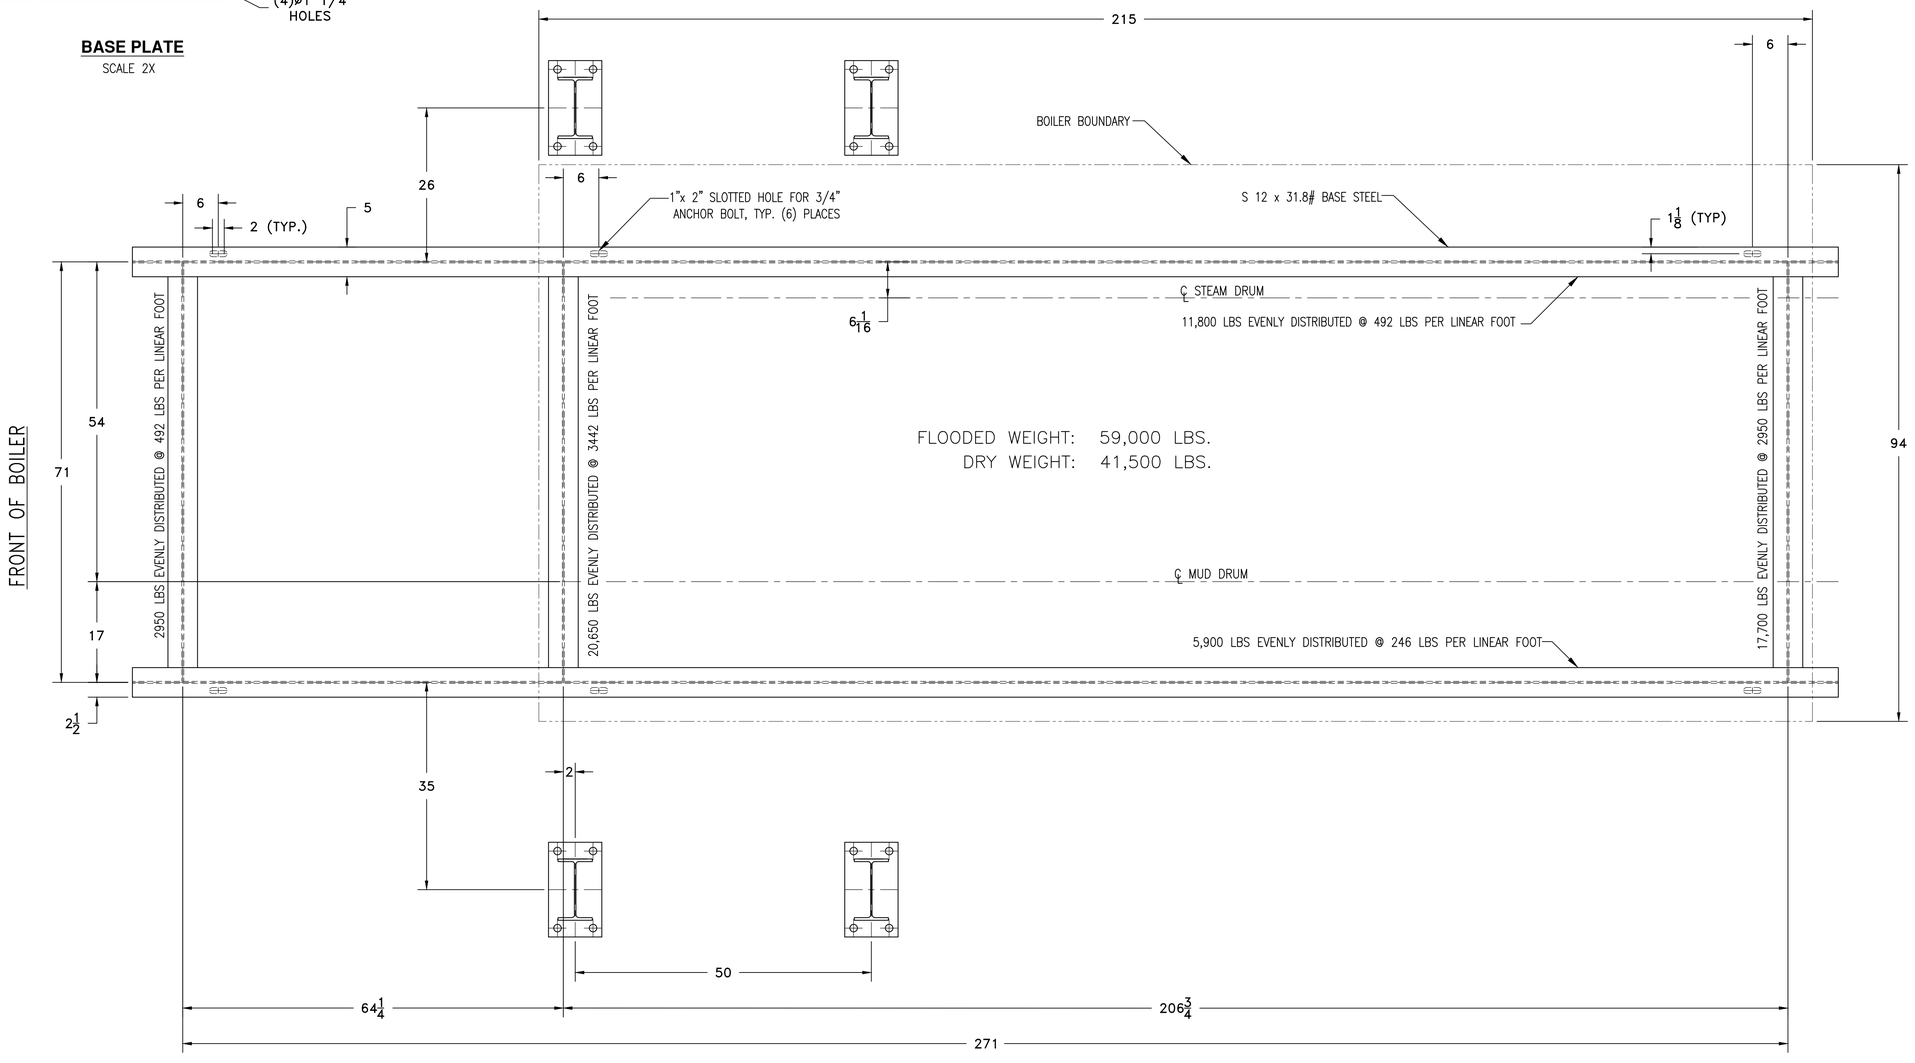

FLOODED WEIGHT: 59,000 LBS.
DRY WEIGHT: 41,500 LBS.

NOTICE
THIS DRAWING AND ALL EXHIBITS SEPARATELY OR COLLECTIVELY DISCLOSED THEREBY OR EMBODIED THEREIN, ARE THE PROPERTY OF ENGLISH BOILER AND TUBE, INC. AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURE OR SALE OF APPARATUS OR APPARATUS PARTS, NOR SHALL THEY BE COMMUNICATED, DISCLOSED, OR USED IN ANY MANNER, IN WHOLE OR IN PART EXCEPT AS AND TO EXTENT PREVIOUSLY EXPRESSLY AUTHORIZED IN WRITING BY THE COMPANY.

DIMENSION LIMITS UNLESS OTHERWISE SPECIFIED ARE
X.X Equals ±0.06
X.XX Equals ±0.015
X.XXX Equals ±0.005
Angles ±0.50°
Fractions ±1/16

ENGLISH BOILER AND TUBE, INC.
2890 SEVEN HILLS BLVD.
RICHMOND, VA. 23231
PHONE: 1-804-226-8227
FAX: 1-804-226-9321

DRAWING NAME: FOUNDATION & LOADING
CONTRACTOR:
PROJECT: NESTLE FREEHOLD

REVISION #		DRAWN	CHECK	APPROVED	REVISION #		DRAWN	CHECK	APPROVED	REVISION #		DRAWN	CHECK	APPROVED	REVISION #		DRAWN	CHECK	APPROVED
REVISION #		DRAWN	CHECK	APPROVED	REVISION #		DRAWN	CHECK	APPROVED	REVISION #		DRAWN	CHECK	APPROVED	REVISION #		DRAWN	CHECK	APPROVED

SCALE	DATE	DRAWN BY	CHECKED BY	APPROVED BY
1" = 1'	9/15/2015	SJ		

SIZE	MODEL NUMBER	DRAWING NUMBER	REV. #
D	30-DS-300	35-042-105	0